


RevNo	Revision note	Date	Signature	Checked

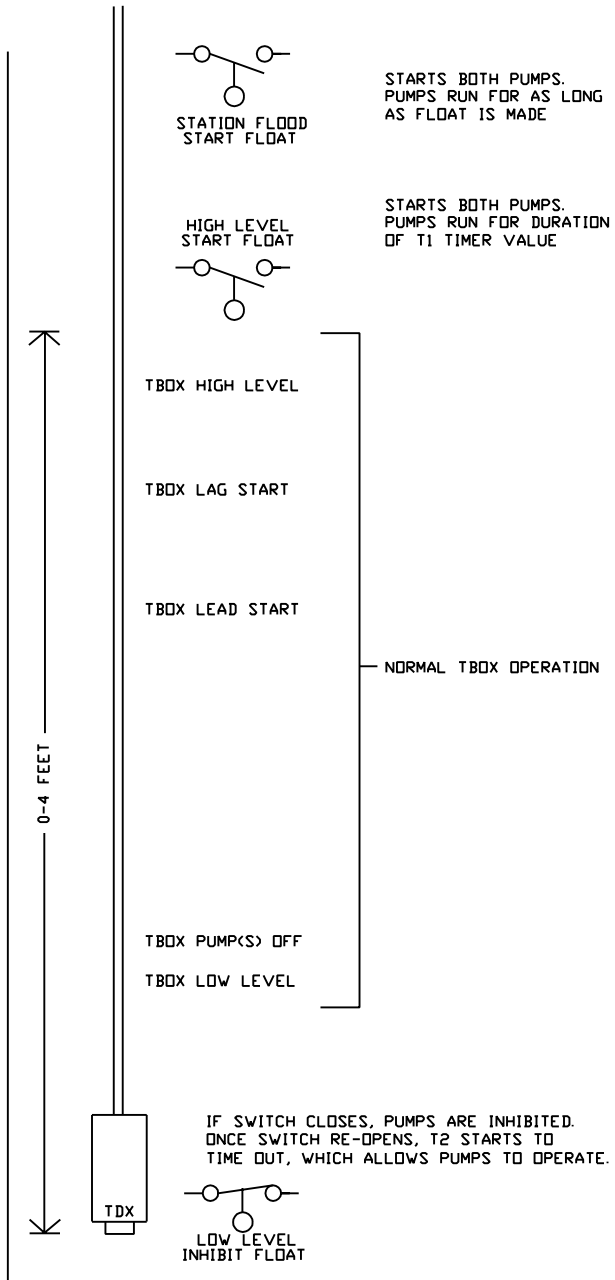

TRANSDUCER IS CAPABLE OF MEASURING 0-12 FEET OF DEPTH  
 TRANSDUCER IS RANGED FOR 0-4 FEET FOR MALCOLM ST.  
 TBOX MODE: PUMPS OPERATE VIA TBOX SETPOINTS - FLOATS OVERRIDE AUTOMATICALLY  
 FLOAT MODE: TBOX HAS NO CONTROL - FLOATS OPERATE PUMPS - T1 CONTROLS PUMP 'ON' TIME

Designed by RBD	Drawn by DMD	Checked by RBD	Approved by - date 10/6/08	Date 10/6/08	Scale NTS
ROSEMONT ENGINEERING, INC. 225 STEDMAN ST. LOWELL, MA 01851			PH. 978-453-9191 FX. 978-453-1919		Filename LIFT STATION DIAGRAM
 WWW.ROSEMONTENG.COM			TOWN OF ??????		
			????? ST PUMP CONTROL	Edition	Sheet 40F4